

**Results**

Cooling tests:

Case	Cool	Cool Fan	Cool Tot	% change
HVAC-1a	25.74563	* Included	25.74563	---
HVAC-1b	20.68106	* Included	20.68106	-19.67%

Criteria

min	max	
-21.24%	-17.38%	pass


Heating tests:


Case	Heat	Heat Fan	Heat Tot	% change
HVAC-2a	936.6354	365.2476	94.91	---
HVAC-2b	811.8225	365.2476	82.43	-13.15%

-13.30%	-11.57%	pass
---------	---------	------

Case	Heat	Heat Fan	Heat Tot	% change
HVAC-2c	35.44759	* Included	35.44759	---
HVAC-2d	26	* Included	26	-27.54%
HVAC-2e	63.81359	* Included	63.81359	80.02%

-29.03%	-16.73%	pass
41.81%	80.81%	pass

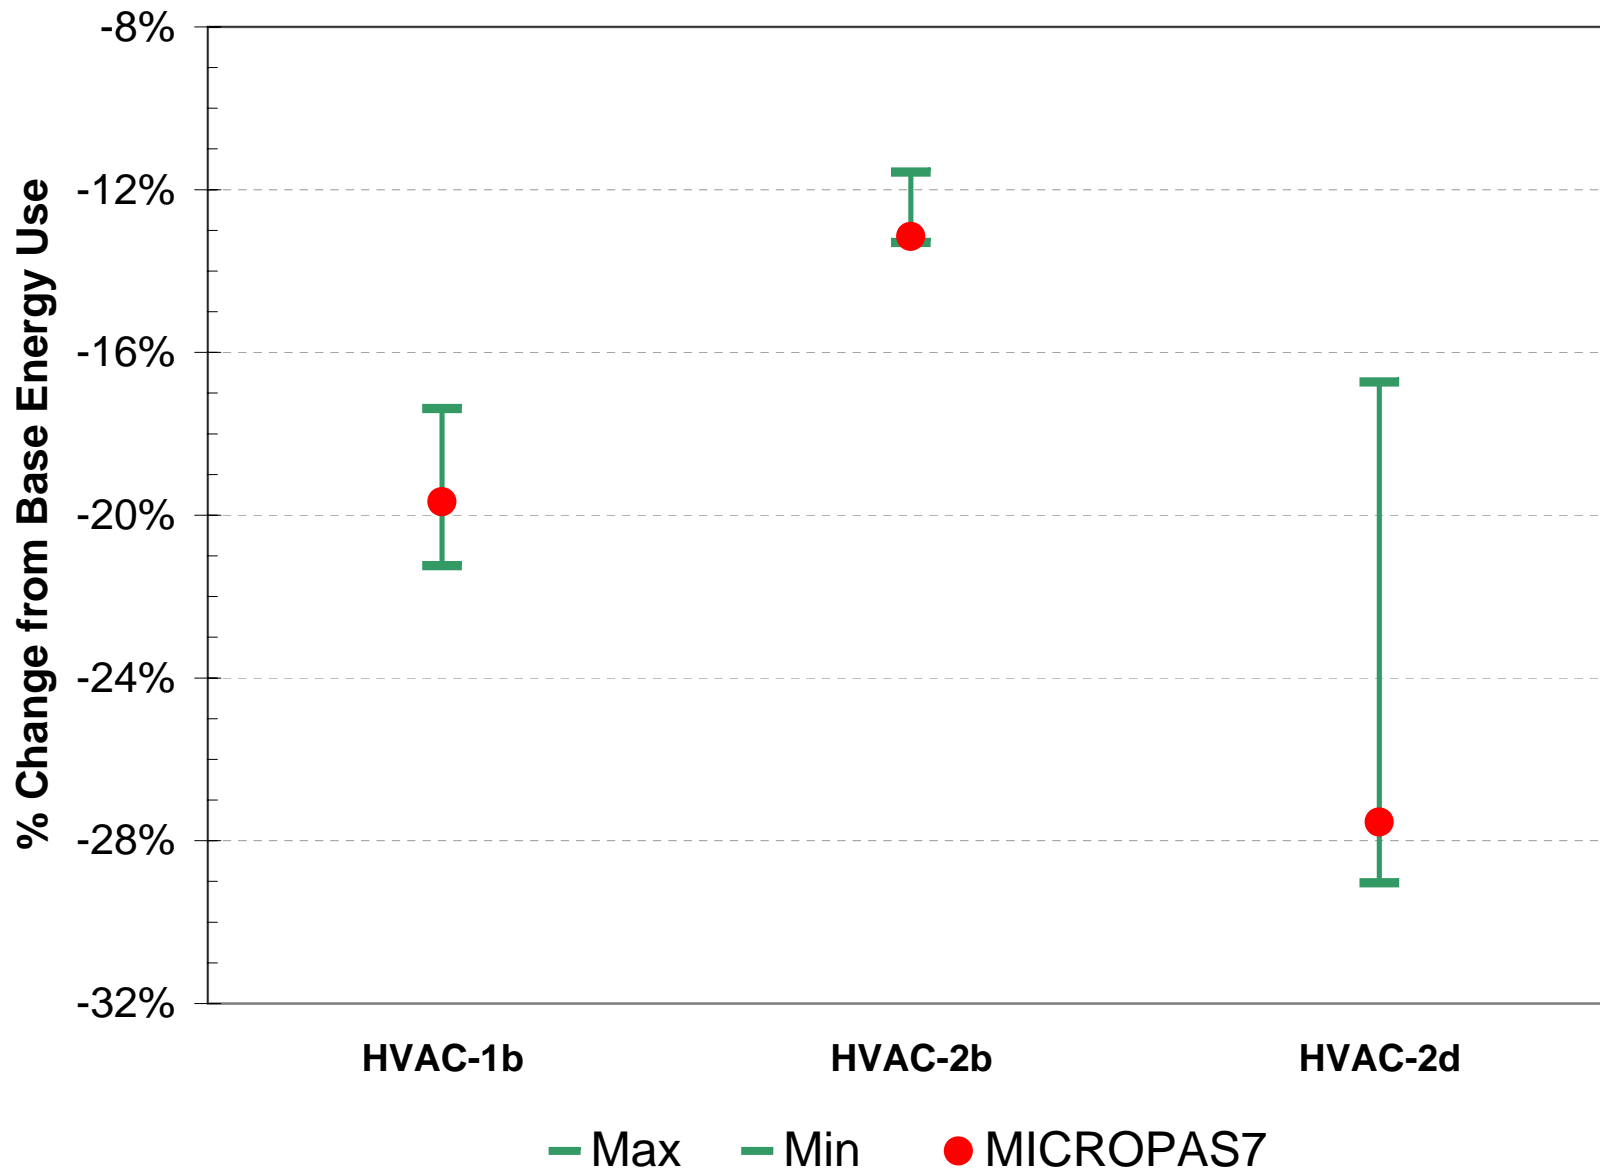

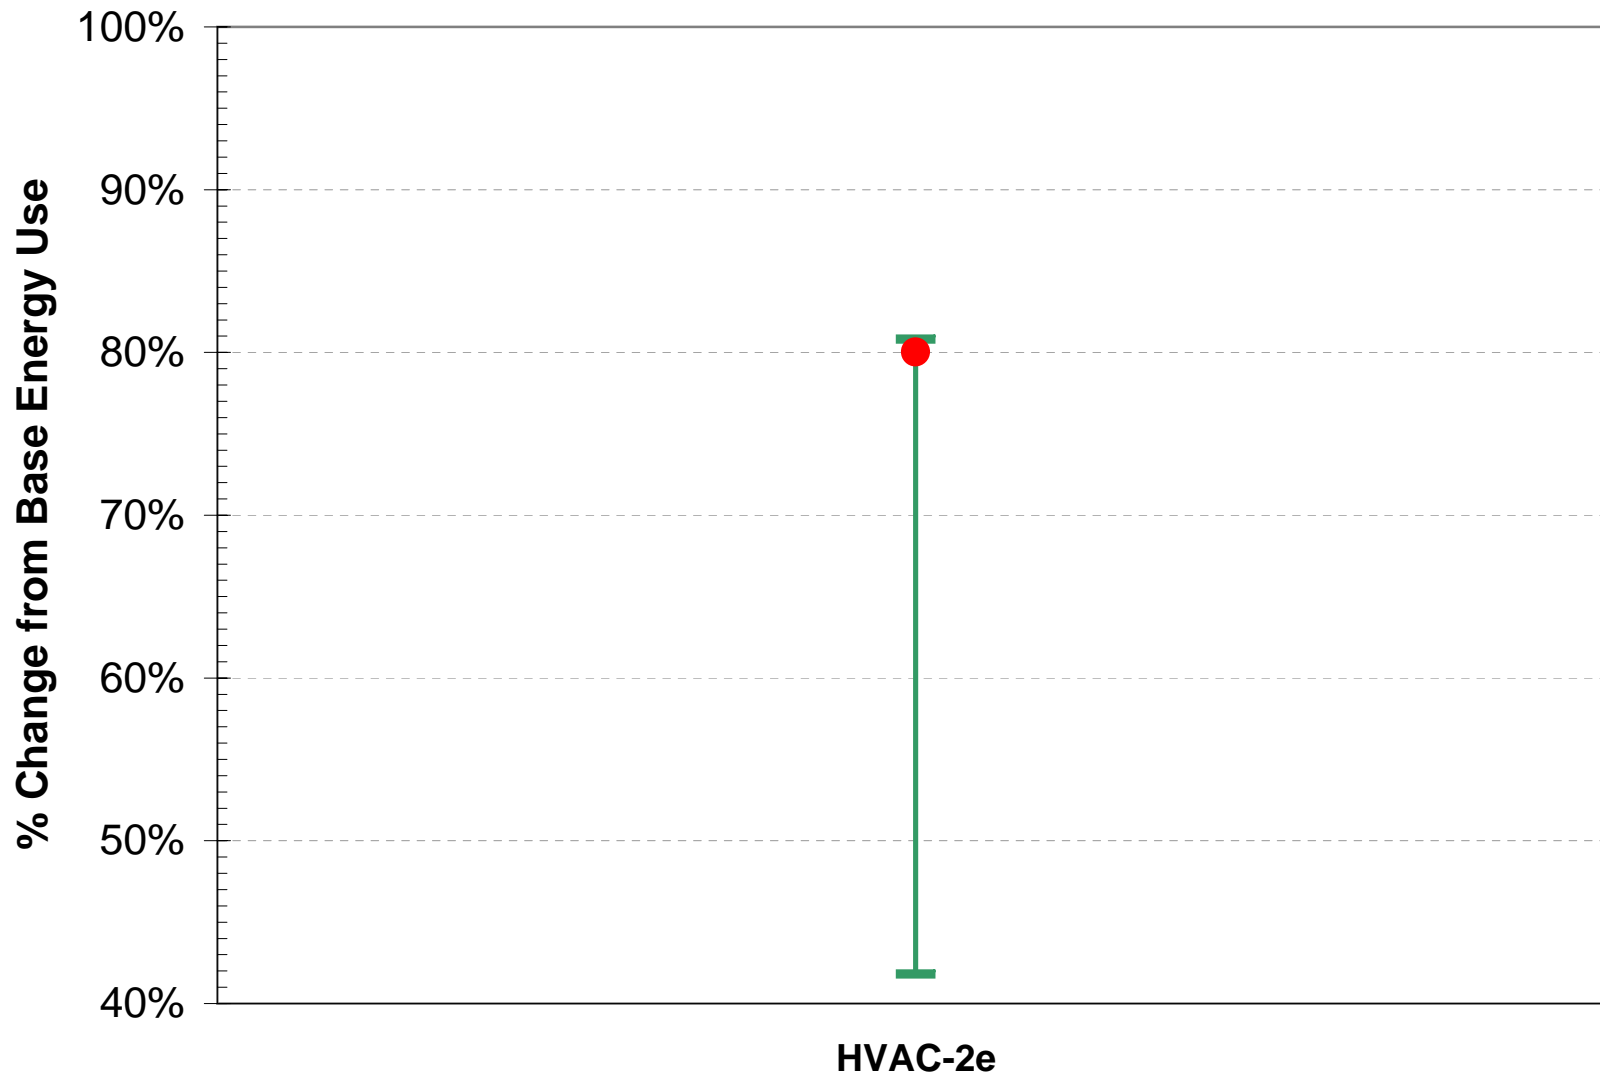

— Max — Min ● MICROPAS7