

Air Flow Measurements

Bill Spohn

TruTech Tools, LTD

Thursday, February 28, 2012

2013 RESNET Conference

Orlando, FL





Anemometer:

**An instrument for measuring
wind speed**

ANN-NIH-MOM-MITTER

**from the Greek anemos = wind
or wind meters**

The AIR facts....

- Even though you cannot see it
 - Air has mass
 - Standard air weighs 0.075 lb/ft^3
 - Air takes up space
- We are not conditioning CFM's of air but rather pounds of it!

What's a CFM?

- C = Cubic
- F = Feet
- M = per Minute
- It's a volume flow rate
- How much air per minute
- $CFM = Velocity \times Area$



Calculating CFM

- An accurate measure of the air velocity is required in FPM
- The speed of the air is multiplied by the cross sectional area to get the CFM
- If the air velocity measurement is incorrect, the CFM will also be improperly calculated!!


Specific Volume

As air is heated or humidified, its specific volume increases and its density decreases



Airflow

- One of the two adjustable parameters on a refrigeration system
- Airflow is critical to proper operation
- Must be set before charge is set measured or adjusted!!!
- System capacity is directly affected by changes in airflow.

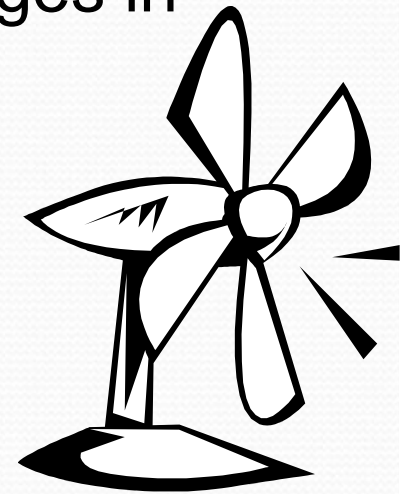

Energy Star on Air Flow



**70% of systems
have improper
airflow**

Considering an ENERGY STAR
CAC/ASHP Specification
for 2006

Appropriate Accuracy is key to useful measurements


- Reasons **FOR** taking measurements
 - I can prove the system operates as the manufacturer intended
 - I know where to start troubleshooting
 - I can eliminate “false causes”
 - I have a “paper trail” of my work
 - I can get better factory support when needed
 - It helps me sleep well at night

Achieving accurate measurements: It's not any one thing.

- There may be error inherent in the
 - Measurement process
 - Positioning of the instrument probe
 - Calculation errors
 - Not factoring in air density
 - Improper techniques and practice
 - Limitations of measurement device or devices
 - Resolution


REMEMBER

There are no theories in HVAC/R!

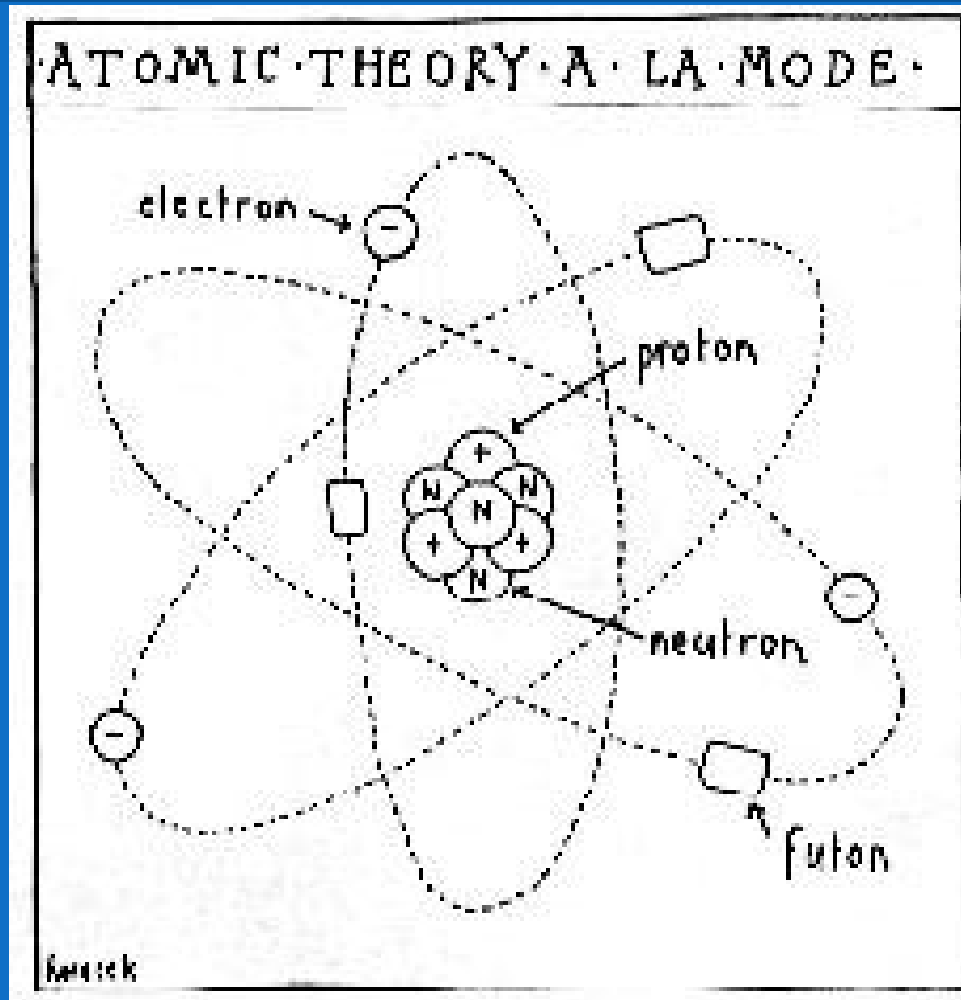

Airflow

- Airflow must **ALWAYS** be set at the appliance first!
 - Airflow is critical to system performance
 - Refrigerant charging requires proper airflow
 - Set to a nominal 400 CFM/Ton for A/C
 - 350 CFM for high humidity
 - Set to 450 CFM/Ton for heat pumps
 - Middle of temperature rise range for furnaces

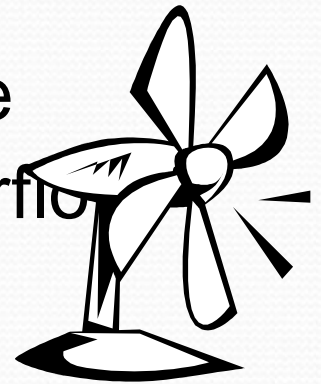


Always refer to manufacturer's specific instructions

After the airflow has been set at the appliance **NEVER** adjust it to change system characteristics!

Issues affecting accuracy

- Density Correction
 - Density error of +/- 10%
 - Airflow accuracy of +/- 5%
- Proper measurement technique
- Accurate sensors

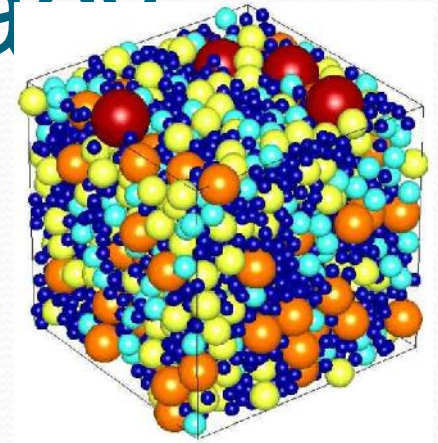

Why density really matters

If the air density is low, more CFM is required to keep the mass flow rate the same!!!

If air density is not considered, many systems will have very low airflow.

The beauty of the fan

The volume of air will not be effected in a given system because a fan will move the same amount of air regardless of the air density. In other words, if a fan will move 3,000 cfm at 70°F it will also move 3,000 cfm at 250°F



Photo: GREENHECK FANS

**If fans move a constant
CFM independent of air
density.....**

**They can measure
airflow independent of air
density too!!!**

Many ways ...

- **Indirect measurements**
 - **Windchill**
 - Your hand, Lick your finger, Hotwire anemometer
 - **Temperature rise with known heat input**
 - **Static Pressure**
 - Pressure drop over known restriction
 - **Pitot Static**
 - Tubes, arrays, grids
 - **Capture devices**
 - Hoods, bags
 - Powered capture device FlowBlaster®
- **Direct measurements**
 - Rotating vane



Measuring techniques In Duct Systems

- Temperature Rise Method
- Pitot Tube
- Thermal Anemometer (Hot Wire)
- Wilson Flow Grid (TrueFlow grid)
- Pressure drops across coils filters and heat exchangers
 - (Provided there is a CFM look up chart)




Measuring techniques at terminals

- Flow Hood/Capture Hood
- Pitot Tube
 - Traverse and average
- Thermal Anemometer (Hot Wire)
 - Traverse and average
- Rotating vane
- FlowBlaster®
- Exhaust fan flow meter



Hot Wire


- How it works
 - Windchill of a heated bead is proportional to the air velocity
- Benefits
 - Broad range, easy to use
- Limitations
 - Denser air has more mass
 - Carries away more heat at a given velocity
 - Subject to contamination
 - Intercepts a small area
- Applications
 - In duct measurements

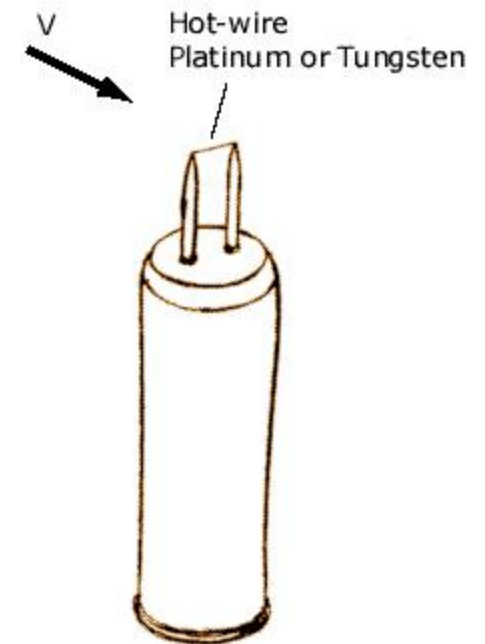

Price range \$300 -\$600

Pitot Tube


- How it works
 - Impact pressure of air is sensed on a pressure sensor
- Benefits
 - Easy to use, cost effective
- Limitations
 - Denser air has more mass, thus more pressure at a given velocity
 - Low velocity only with precise manometer with calculation
- Applications
 - In duct measurement

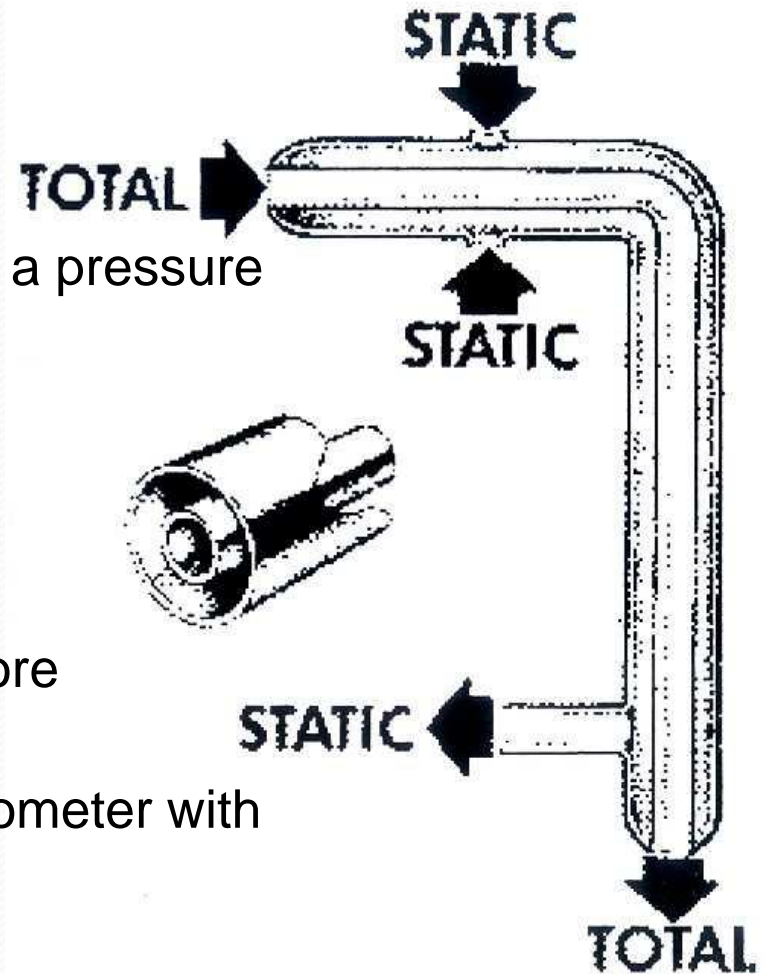

Price range \$250 -\$400

TrueFlow® Plate Pitot Array or Flow Grid


- How it works
 - Like a multiple Pitot Tubes yielding an average velocity sampled over large area
- Benefits
 - Fast to set up, adjustable
 - Central return or in filter slot
- Limitations
 - Same as those of a Pitot tube
 - Not exactly the same as “run conditions”
 - Needs digital manometer
- Applications
 - System airflow

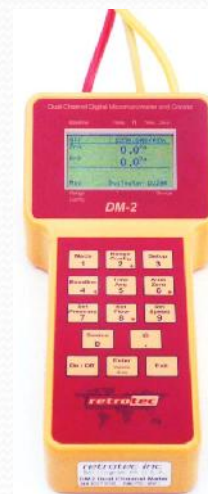

Cost ~ \$800 + \$750 = \$1550

Static Pressure Drop

- How it works
 - The Static pressure “half” of a Pitot tube
 - Need to measurements of static pressure over a know air flow resistance
- Benefits
 - Low cost
 - Easy to set up and use
 - Need a digital manometer, too
- Limitations
 - Results depend on the equipment mfr. tables
 - The “known resistance” often changes
 - “wet coil” how wet is wet, dirty coils
 - Velocity drag at walls of duct
 - CAREFUL DRILLING INTO THINGS!
- Applications
 - In duct measurement

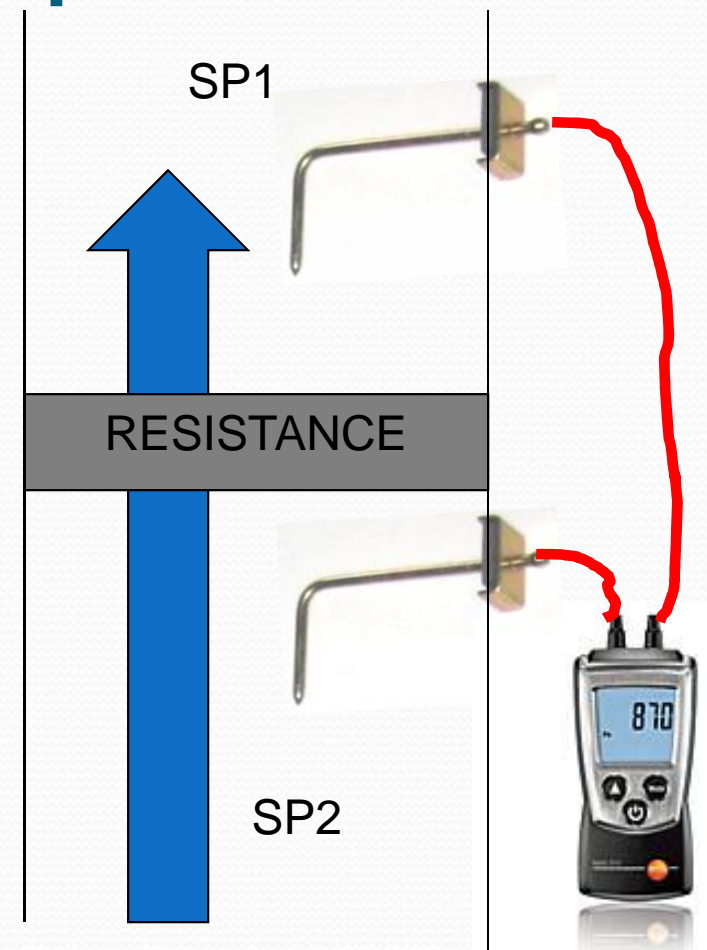

Price \$220


Total External Static Pressure

- Airflow in CFM is measured by the manufacturer
- Pressure drop across the heat exchanger or evaporator coil is measured.
- If a pressure drop and a CFM are known, a new CFM can be calculated at any measured pressure drop.
- Can only be used as an estimating tool for airflow without manufacturer's literature.
- The industry standard for TESP in equipment design is ½"wc, ranges from 0.3-1.0" H2O are possible
- ECM motors make it a new ballgame

AIRFLOW PERFORMANCE DATA

Model Cabinet Size	Electric Heaters	Blower Motor		CFM WATTS RPM	External Static Pressure - In. W.C.								
		Speed	Volts*		.10	.20	.30	.40	.50	.60	.70	.80	.90
-21	None	Low	230		1009 [126] 559	1011 [144] 608	1010 [162] 656	1008 [180] 701	1004 [199] 747	1000 [219] 790	997 [239] 833	997 [260] 874	999 [282] 915
	4 (Max.)	Low	230		987 [127] 575	985 [148] 633	982 [168] 688	978 [189] 738	974 [210] 788	970 [232] 833	967 [255] 879	965 [278] 922	966 [303] 965
	None	Low	208		993 [117] 550	990 [133] 600	988 [150] 649	987 [169] 695	986 [189] 741	986 [209] 785	986 [231] 830	986 [251] 870	986 [272] 911
	4 (Max.)	Low	208		981 [122] 559	974 [140] 621	969 [161] 681	967 [183] 734	965 [205] 788	964 [229] 835	963 [252] 883	962 [274] 928	959 [295] 968
	None	High	230		1196 [193] 638	1199 [216] 681	1201 [240] 725	1203 [265] 766	1205 [290] 807	1206 [316] 846	1208 [341] 885	1209 [366] 923	1210 [390] 961
	4 (Max.)	High	230		1185 [208] 665	1169 [222] 709	1166 [246] 755	1172 [276] 802	1181 [309] 850	1190 [343] 895	1192 [373] 940	1184 [396] 977	116 [40] 10
	None	High	208		1171 [181] 626	1171 [201] 672	1174 [224] 717	1179 [249] 761	1184 [275] 805	1189 [301] 845	1193 [327] 886	1195 [351] 922	1199 [377] 961
	4 (Max.)	High	208		1153 [191] 647	1146 [210] 696	1149 [235] 745	1156 [265] 793	1164 [296] 842	1171 [327] 887	1173 [355] 932	1165 [377] 971	1169 [399] 1000
	None	Low	230		1423 [221] 573	1422 [245] 615	1419 [271] 657	1415 [298] 699	1410 [326] 740	1406 [355] 781	1401 [386] 820	1397 [417] 860	
	5 (Max.)	Low	230		1420 [242]	1416 [272]	1413 [306]	1411 [342]	1408 [381]	1404 [421]	1400 [460]	1395 [498]	950


ESP – External Static Pressure

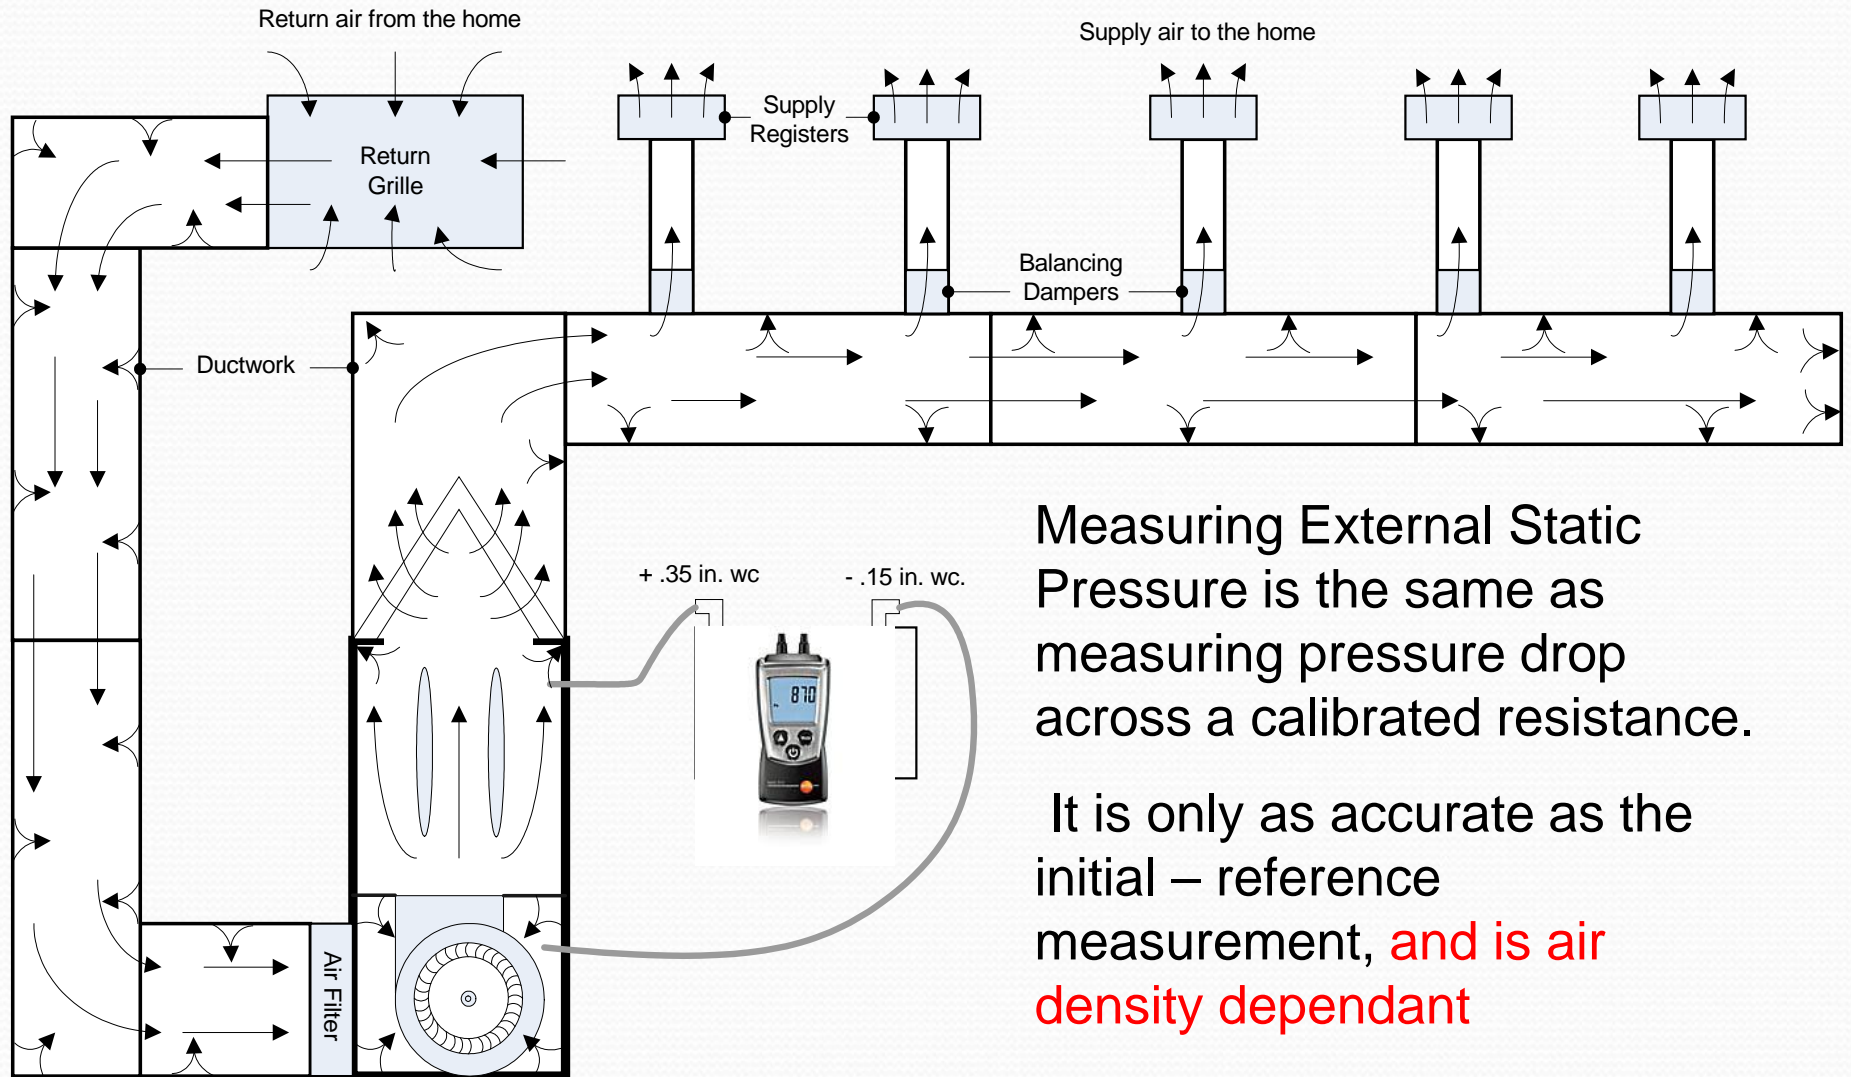

Measuring External Static Pressure is the same as measuring pressure drop across a calibrated resistance.

It is only as accurate as the initial – reference measurement, **and is air density dependant**

Pressure Drop Across the Evaporator Coil

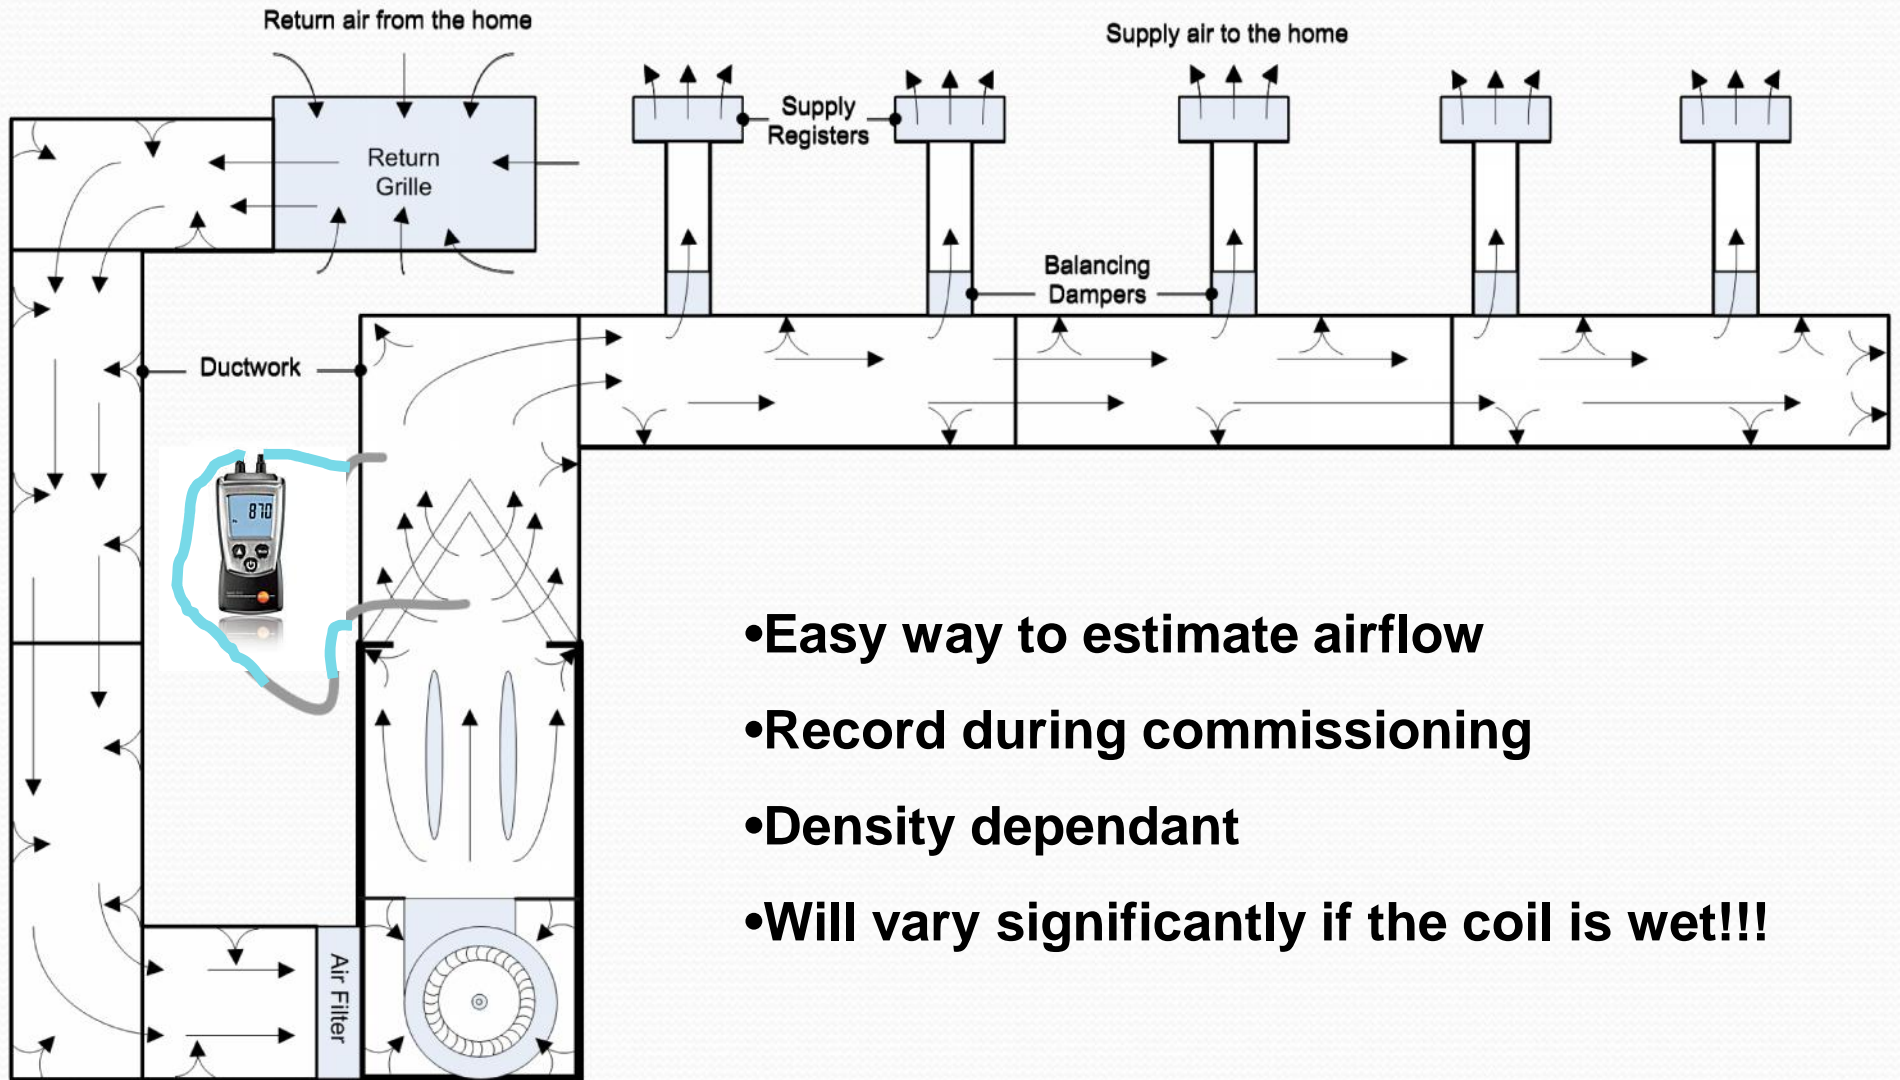

- Easy way to estimate airflow
- Record during commissioning
- Density dependant
- Will vary significantly if the coil is wet!!!



**Large static pressure drops
across system components like**

- Coils
- Filters
- Secondary heat exchangers

**Indicate excess restrictions
normally due to dirt!**

Vane Anemometer

- How it works
 - Propeller rotates proportional to the speed of the air
- Benefits
 - No need for density correction
 - Averages over large or “large” small area
 - Minimally invasive
- Limitations
 - Turbulence
 - Angular orientation during test
 - Small error: 10% off angle, 1% error
 - Friction of propeller
- Large Vane Applications:
 - Supplies & returns
 - Especially flex duct systems
- Mini-Vane Applications:
 - In duct on hard duct systems



Price range \$500 - \$700

Scoops, mini-hoods and funnels

- Not to be used at volume flows above about 75 CFM
- Due to back pressure



Exhaust Fan Flow Meter

- *Used for exhaust fan flow*
- *Requires a precision manometer*
 - *Pascal read out*
- *Measuring range 10 to 124 CFM*
- *Display on DG700 or DM2A Gives readings*
 - *Or Sticker on unit gives readings*
- *When placed over a fan grill, air is drawn through the calibrated opening.*
- *The opening is adjusted by the user to minimize back pressure while maximizing accuracy*



Cost \$135 + Precision Digital manometer

Where to Make IN Duct Measurements



Look for:

- Straight sections of duct 2-3 duct diameters away from turns and fittings.

Ideal location on a traditionally ducted system

Mini Vane

- Non-invasive measurement
- Excellent repeatability
- Forgiving to operator error
 - 10% change in yaw or pitch yields error of less than 1%



Measure Air Velocity and CFM

Mini Vane

- *Airflow in under 3 minutes*
- *Full duct traverse assures accuracy (timed or point)*
- *Large (small probe) is not affected by stray eddy currents*
- *Ultra low mass rotating vane*
- *Precision jewel bearings for low breakaway torque*
- *Excellent durability and chemical and kid resistance.*
- **No air density correction required.**



Capture Devices

- Plastic Bag & stop watch
 - Cheap! Accurate? Repeatable?
- Flow hoods
 - Pitot array
 - Hot Wire measurement
- Benefits
 - Fast to set up and use
- Limitations
 - Accuracy is mass dependent



Flow Hoods

Pitot static array

Fast, one person snapshot operation

Multi-functional

Detachable digital manometer: Pitot, airflow, temperature, velocity matrix, or relative humidity probes.

Back pressure compensated

Multiple hood sizes/models available

500 & 2500 CFM

\$1500 to \$3200



FLOWBLASTER®

Auto compensates for Back pressure

A powered flow hood!

Grill skirt

Digital
Manometer
Fan
controller

Measurement
Array

Compensating
Fan
(DuctBlaster®)

(Battery pack)

Attaches to a DuctBlaster® COST = ~ \$1100 + \$1875



Powered Flow Hood

\$150 accessory for on ANY brand of
Duct Leakage Tester

Up to 650 CFM supply or return flows
(Zip poles not included - ~\$30)

Still usable as a Pressure pan



**Pressure Pans for use as
Powered Flow Hood
#PP105**



airflow systems since 1980

www.retrotec.com



Thank you!

Presented by: Bill Spohn
President & CEO

DOWNLOADS ,GUIDES AND VIDEOS at → www.TruTechTools.com

412-721-5544 cell

Bill@TruTechTools.com

www.TruTechTools.com/Videos